

# Pressure switch for gas DG

Technical Information · GB

4 Edition 05.13



- Monitoring of gas and air pressures (positive, negative and differential pressures)
- EC type-tested and certified pursuant to EN 1854 and class "S"
- DG..T: FM approved and UL listed
- Certified pursuant to GOST-R and AGA
- Certified for systems up to SIL 3 and PL e
- Pressure switch with internal lock and manual reset
- Suitable for biologically produced methane (can be used on pipes with Zone 2 explosive atmospheres without isolating amplifier)
- With approved isolating amplifier for Zone 1 and 2 hazardous areas
- RoHS 2002/95/EC
- DG..S: special version available for NH<sub>3</sub> and O<sub>2</sub>

# Contents

Pressure switch for gas DG .....	1	6 Accessories .....	19
Contents .....	2	6.1 Fastening set with screws, U-shape bracket. ....	19
1 Application .....	4	6.2 Connecting set .....	19
1.1 Examples of application .....	5	6.3 External adjustment .....	19
1.1.1 Gas deficiency monitoring .....	5	6.4 Pressure equalization element .....	19
1.1.2 Differential pressure monitoring .....	5	6.5 Restrictor orifice .....	20
1.1.3 Systems leak tightness check .....	5	6.6 Test key PIA .....	20
1.1.4 Negative pressure monitoring .....	5	6.7 Filter pad set .....	20
1.1.5 Air line with minimum pressure and flow monitoring .....	6	6.8 Tube set .....	20
1.1.6 Low-pressure cut-off and high gas pressure protection device .....	6	6.9 Standard socket set .....	20
2 Certification .....	7	6.10 Standard coupler plug .....	20
2.1 Overview .....	8	6.11 Pilot lamp set, red or blue .....	21
3 Function .....	9	6.12 LED set, red/green .....	21
3.1 Positive pressure measurement .....	9	7 Technical data .....	22
3.2 Negative pressure measurement .....	9	7.1 Adjusting range, switching hysteresis .....	23
3.3 Differential pressure measurement .....	9	7.2 Safety-specific characteristic values for DG .....	24
3.4 Connection diagram .....	10	7.2.1 Determining the PFH <sub>D</sub> value, the λ <sub>D</sub> value and the MTTF <sub>d</sub> value .....	25
3.4.1 DG..T, blue pilot lamp for 230 V AC or DG..N, blue pilot lamp for 120 V AC .....	10	7.2.2 Calculating the PFH <sub>D</sub> .....	25
3.4.2 DG..T, DG..N with plug .....	10	7.3 Dimensions .....	28
3.4.3 DG..K2, red/green pilot LED for 24 V DC/AC or DG.. T2, red/green pilot LED for 230 V AC .....	10	8 Maintenance cycles .....	28
3.4.4 DG..K2, DG.. T2 with plug .....	10	9 Glossary .....	29
3.5 Wiring .....	11	9.1 Diagnostic coverage DC .....	29
3.6 DG in Zone 1 (21) and 2 (22) hazardous areas .....	12	9.2 Mode of operation .....	29
3.7 DG on pipes with Zone 2 (22) explosive atmospheres .....	13	9.3 Category .....	29
3.8 Animation .....	14	9.4 Common cause failure CCF .....	29
4 Selection .....	15	9.5 Fraction of undetected common cause failures β .....	29
4.1 Selection table .....	15	9.6 B <sub>10d</sub> value .....	29
4.2 Type code .....	16	9.7 T <sub>10d</sub> value .....	29
5 Project planning information .....	17	9.8 Hardware fault tolerance HFT .....	29
5.1 Installation .....	17	9.9 Mean dangerous failure rate λ <sub>D</sub> .....	29
		9.10 Safe failure fraction SFF .....	30

9.11 Probability of dangerous failure  $PF_{H_d}$  ..... 30

9.12 Mean time to dangerous failure  $MTTF_d$  ..... 30

9.13 Demand rate  $n_{op}$  ..... 30

Feedback ..... 31

Contact ..... 31



## 1 Application



DG..U-3

Adjustable switching point

DG..H, DG..N

DG..H: switches and locks off with rising pressure. DG..N: switches and locks off with falling pressure. Manual reset.

DG..-6

With fitted socket pursuant to DIN EN 175301-803

DG..T

Hand wheel with "WC and mbar scale. NPT conduit for electrical connection.

The gas pressure switch DG monitors extremely low pressure differentials and triggers switch-on, switch-off or switch-over operations if a set switching point is reached. The switching point is adjustable via a hand wheel.


It monitors positive and negative gas pressures on various industrial gas and air appliances, such as boiler fan monitoring and differential pressure monitoring in firing, ventilation and air-conditioning systems.

The TÜV-tested special-design pressure switch is used as defined by VdTÜV Code of Practice "Druck 100/1" (Pressure 100/1) in firing installations for steam and hot-water generators in accordance with TRD 604, Para. 3.6.4, as well as class "S" for DG..B, DG..U and DG..I pursuant to EN 1854.

Type	Positive pressure	Negative pressure	Differential pressure
DG..B	Gas, air, flue gas or biomethane	–	–
DG..U, DG..T	Gas, air, flue gas or biomethane	Air or flue gas	Air or flue gas
DG..H, DG..N, DG..HT, DG..NT	Gas, air, flue gas or biomethane	Air or flue gas	Air or flue gas
DG..I	Air or flue gas	Gas, air, flue gas or biomethane	Air or flue gas
DG..S	NH <sub>3</sub> or O <sub>2</sub>	–	–


## 1.1 Examples of application

### 1.1.1 Gas deficiency monitoring

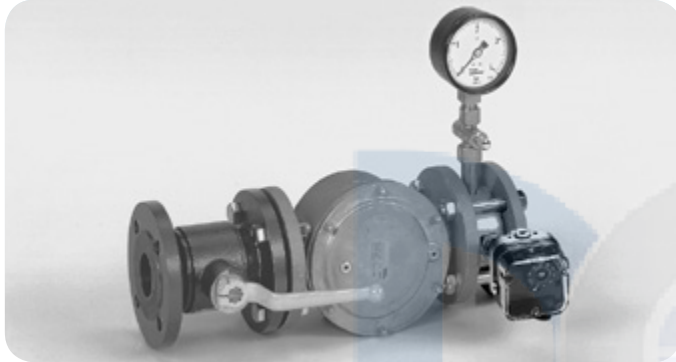


For monitoring the minimum gas inlet pressure

### 1.1.2 Differential pressure monitoring

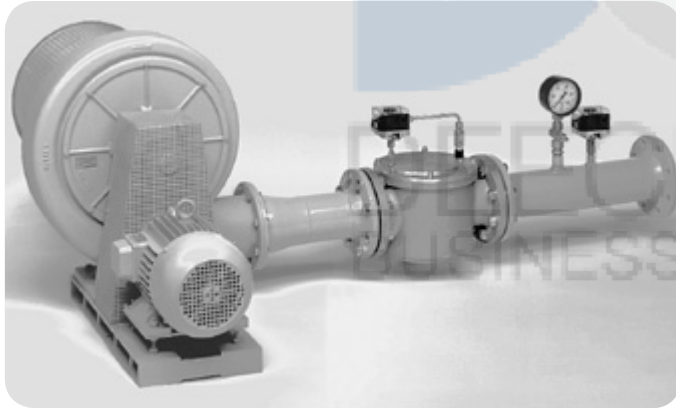

Differential pressure switch for monitoring air filters

### 1.1.3 Systems leak tightness check

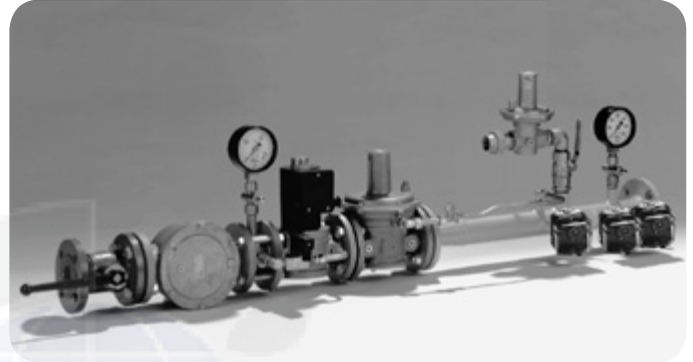


Electronic safety shut-off valve SAV with closed position check of downstream devices.

### 1.1.4 Negative pressure monitoring



Monitoring the negative pressure ensures the correct positioning of the components during fully automatic assembly of gas meters.

### 1.1.5 Air line with minimum pressure and flow monitoring

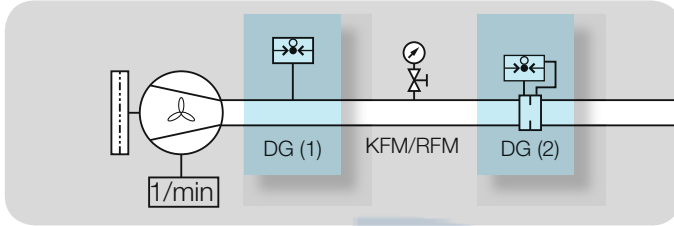


The air flow generated by the fan may be monitored as follows:

The static pressure is monitored by pressure switch DG (1), as long as it can be demonstrated that the display consequently shows an adequate and secured flow of air, or

DG (2) controls the flow of air via the differential pressure on the orifice.

If there is no air pressure supplied or if there is no differential pressure on the orifice, the system will be blocked.

### 1.1.6 Low-pressure cut-off and high gas pressure protection device

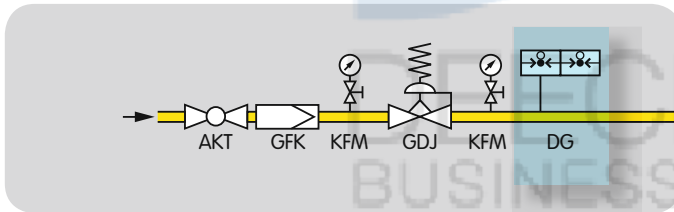

If the pressure is either too low or too high, the min./max. pressure switch DG switches in order to avoid start-up or to initiate a safety shut-down.

## 2 Certification

SIL and PL certified\*



For systems up to SIL 3 pursuant to EN 61508 and PL e pursuant to ISO 13849

EC type-tested and certified\*



pursuant to

- Gas Appliances Directive (2009/142/EC) in conjunction with EN 1854, Class “S”

Meets the requirements of the

- Low Voltage Directive (2006/95/EC)
- Declaration of conformity (D, GB) – see [www.docuthek.com](http://www.docuthek.com) → Elster Kromschroder → Kromschroder, LBE → Products → 04 Pressure switches → Pressure switches for gas DG → Kind of document: Certificate → DG (K OS Konformitätserklärung)

AGA approval\*



Australian Gas Association, Approval No.: 5484

[http://www.agasn.au/product\\_directory](http://www.agasn.au/product_directory)

Approval for Russia\*



Certified by Gosstandart pursuant to GOST-R.

Approved by Rostekhnadzor (RTN).

Scan of the approval for Russia (RUS) – see [www.docuthek.com](http://www.docuthek.com) → Elster Kromschroder → Kromschroder, LBE → Products → 04 Pressure switches → Pressure switches for gas DG → Kind of document: Certificate → DG B12185 (nationales Zertifikat Russland) (RUS)

DG..T: FM approval\*



Factory Mutual Research Class: 3510 Flow and pressure safety switches.

Designed for applications pursuant to NFPA 85 and NFPA 86. [www.approvalguide.com](http://www.approvalguide.com)

DG..T: UL approval\*










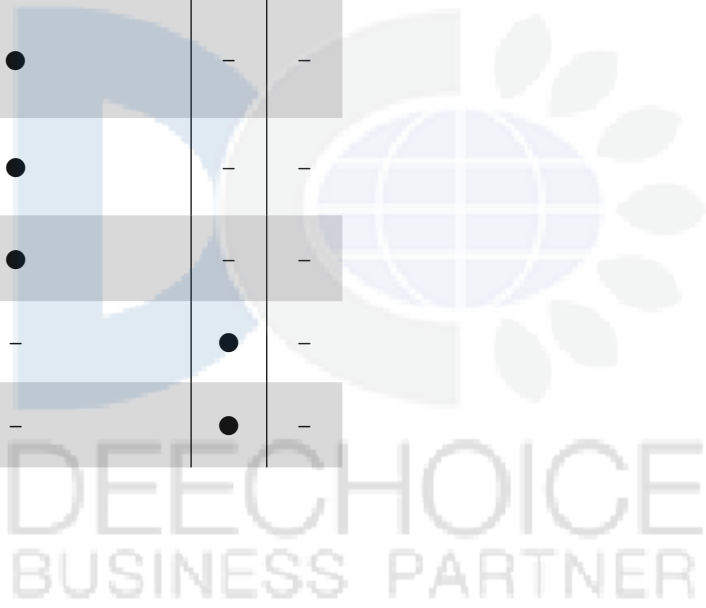
UL 353 Limit control.

Underwriters Laboratories – [www.ul.com](http://www.ul.com) → Certification.


\* Approval does not apply to DG..S. DG..S complies with the requirements of the Low Voltage Directive (2006/95/EC).

2.1 Overview


	DG..B, DG..U, DG..H, DG..N, DG..I	DG..T	DG..S
	●	-	-
	●	-	●
	●	-	-
	●	-	-
	●	-	-
	-	●	-
	-	●	-



### 3 Function

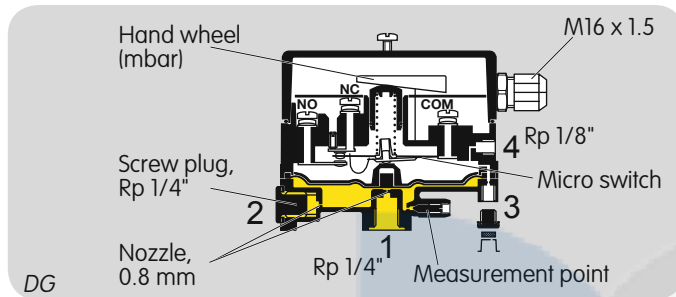


DG

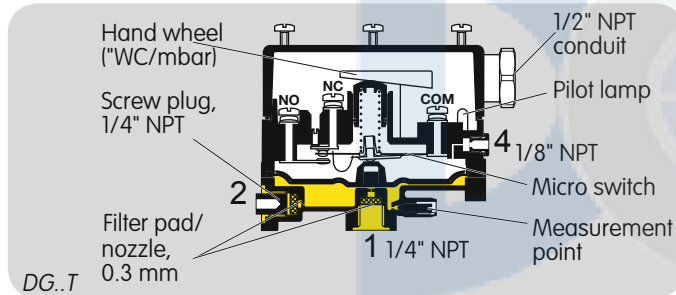

DG..T

The pressure switch DG switches in the event of increasing or decreasing pressure. Once the set switching point is reached, a micro switch is activated in the DG which is designed as a change-over contact.

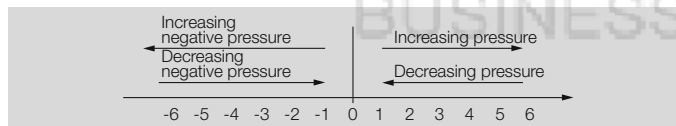

The switching pressure is adjusted using a hand wheel.

### 3.1 Positive pressure measurement

Positive pressure measurement is designed, for example, for checking the fan function or measuring the min./max. gas pressure.

The positive pressure is measured in the lower diaphragm chamber, port 1 or 2.

The upper diaphragm chamber is ventilated via port 3 or 4.

### 3.2 Negative pressure measurement

Negative pressure measurement (air, flue gas) is designed, for example, for monitoring a suction pressure blower. The negative pressure is measured in the upper diaphragm chamber, port 3 or 4, and on DG..T via port 4. The lower diaphragm chamber is ventilated via port 1 or 2.


In the case of DG..I, the negative pressure (gas, air, flue gas or biologically produced methane) is measured in the lower diaphragm chamber, port 1 or 2. The upper diaphragm chamber is ventilated via port 3 or 4.

### 3.3 Differential pressure measurement

Differential pressure measurement is designed for instance for safeguarding an air flow rate or for monitoring filters and fans.

DG..U, DG..H, DG..N: the higher absolute pressure is connected to port 1 or 2, and the lower absolute pressure to port 3 or 4. The remaining ports must be tightly plugged.

### 3.4 Connection diagram

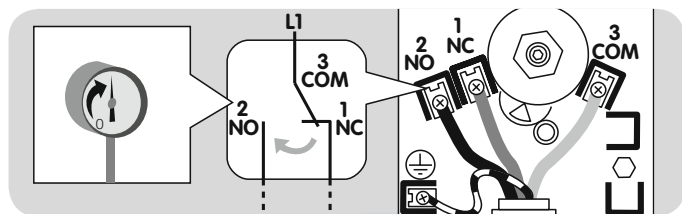



Contacts 3 and 2 close when subject to increasing pressure.  
Contacts 1 and 3 close when subject to falling pressure.

DG..B, DG..U, DG..H, DG..I and DG..T switch with rising pressure. The contact switches from NC 1 to NO 2.


DG..N switches with falling pressure. The contact switches from NO 2 to NC 1.

DG..H, DG..HT, DG..N and DG..NT are locked off in their switched state and can only be unlocked with a manual reset.


#### 3.4.1 DG..T, blue pilot lamp for 230 V AC or DG..N, blue pilot lamp for 120 V AC

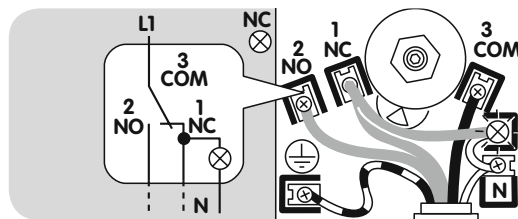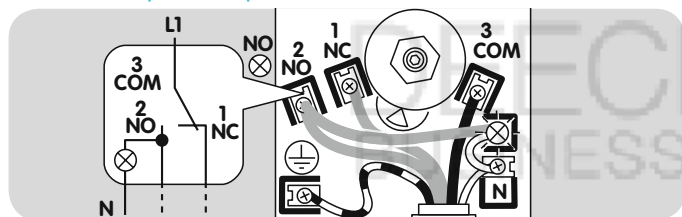


#### 3.4.2 DG..T, DG..N with plug

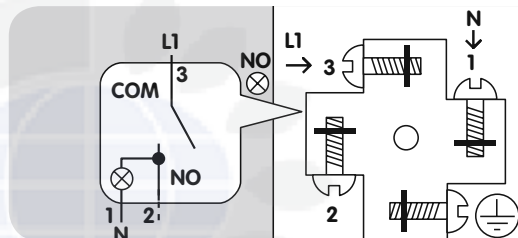

#### 3.4.3 DG..K2, red/green pilot LED for 24 V DC/AC or DG..T2, red/green pilot LED for 230 V AC

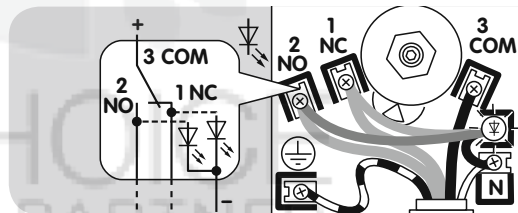


#### 3.4.4 DG..K2, DG..T2 with plug

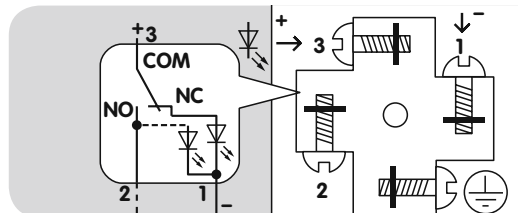

### 3.5 Wiring


If the DG (DG..TG) has switched a voltage > 24 V and a current > 0.1 A at  $\cos \varphi = 1$  or > 0.05 A at  $\cos \varphi = 0.6$  once, the gold plating on the contacts will have been burnt through. It can then only be operated at this power rating or higher power rating.

When using silicone tubes, only use silicone tubes which have been sufficiently cured. Vapours containing silicone can adversely affect the functioning of electrical contacts. In the case of low switching capacities, such as 24 V, 8 mA, for example, we recommend using an RC module (22  $\Omega$ , 1  $\mu$ F) in air containing silicone or oil.

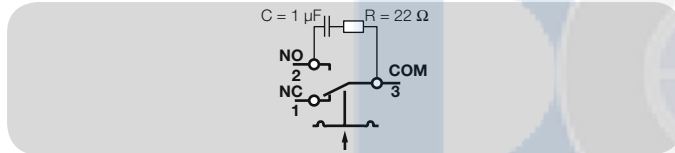


In the case of high humidity or aggressive gas components (H<sub>2</sub>S), we recommend using a pressure switch with gold contact due to its higher resistance to corrosion. Closed-circuit current monitoring is recommended under difficult operating conditions.

#### DG..B, DG..U, DG..H, DG..N

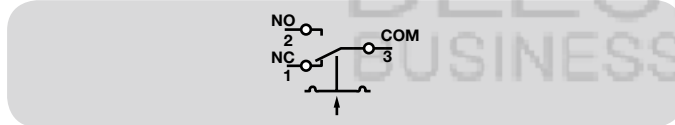

Contacts 3 and 2 close when subject to increasing pressure. Contacts 1 and 3 close when subject to falling pressure.


#### DG 18I, DG 120I, DG 450I

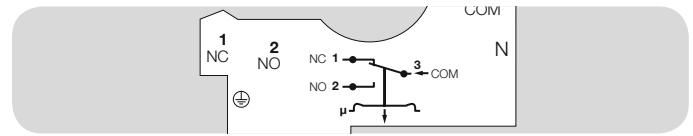


Contacts 3 and 2 close when subject to increasing negative pressure. Contacts 1 and 3 close when subject to falling negative pressure.

#### DG 1,5I and DG 12I


The connection of DG 1,5I and DG 12I depends on the positive or negative adjusting range.

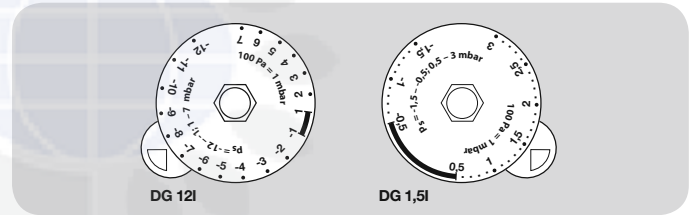

In the negative adjusting range, the template which can be found in the unit displays the connection diagram.

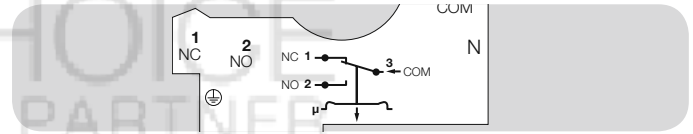

In the positive adjusting range, remove the template and wire the unit as shown in the engraved connection diagram.

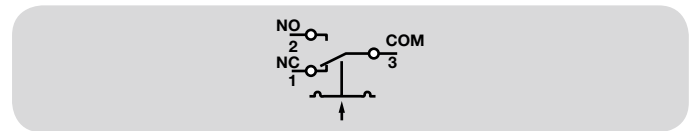

### 3.6 DG in Zone 1 (21) and 2 (22) hazardous areas

Pressure switch DG can be used in Zone 1 (21) and 2 (22) hazardous areas if an isolating amplifier is installed upstream in the safe area as "Ex-i" equipment pursuant to EN 60079-11 (VDE 0170-7):2007.


DG as "simple electrical equipment" pursuant to EN 60079-11:2007 corresponds to the Temperature class T6, Group II. The internal inductance/capacitance is  $L_0 = 0.2 \mu\text{H}/C_0 = 8 \text{ pF}$ .

The isolating amplifier transfers the DG's signals from the explosion-hazard area to the safe area. Depending on the design of the intrinsically safe circuit, the explosion-hazard area can be monitored for cable faults, cable breaks or short-circuits.


Ensure that standard-compliant wiring pursuant to EN 60079 is used.

When operating in Zones 21 and 22, the 1/8" connecting thread or the tube connection for the surrounding air or medium connection must be protected from dirt particles by a separate filter.


#### Intrinsically safe circuit without monitoring for cable faults

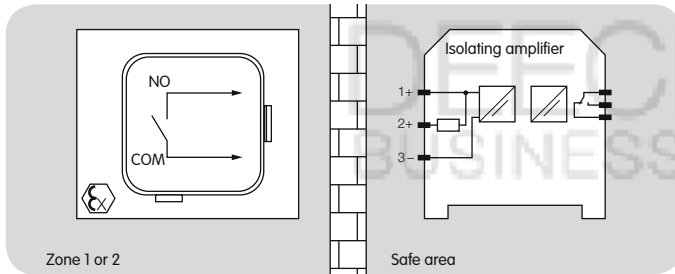

#### Intrinsically safe circuit with monitoring for cable breaks

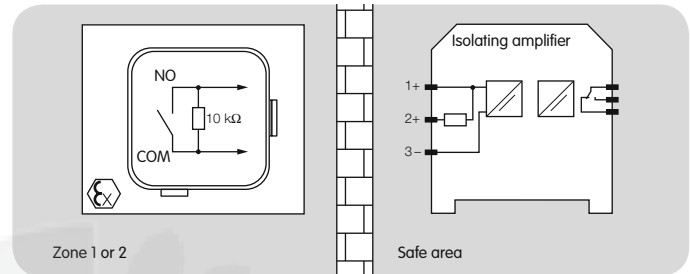

#### Intrinsically safe circuit with monitoring for cable faults and short-circuits

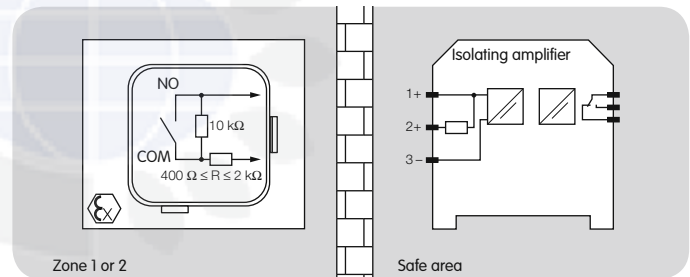

### 3.7 DG on pipes with Zone 2 (22) explosive atmospheres

Pressure switch DG can be connected to pipes/rooms in which Zone 2 (22) explosive gases or dust are present without an isolating amplifier.

The connection to Zone 2, Zone 22 must be implemented via one of the two ¼" threads. Even in the unlikely event of a break in the diaphragm, there is no danger of flashback into the system. The pressure compensation holes on the pressure switch (¼" connections) have a defined ignition protection, in terms of the safety measure for "enclosed-break devices for Group IIA gases and vapours", pursuant to IEC/EN 60079-15:2005.

In the case of Zone 22, it must be ensured that dirt particles do not block the pressure supply hole ( $\varnothing = 0.8$  mm).

The logo features a stylized globe with a grid pattern, surrounded by leaf-like shapes. Below the globe, the text "DEECHOICE" is written in a large, bold, sans-serif font, and "BUSINESS PARTNER" is written in a smaller, all-caps, sans-serif font below it.

DEECHOICE  
BUSINESS PARTNER

## 3.8 Animation

**DG Teilebezeichnung/Part designation**

**kromschroder**

The diagram shows a cross-section of a gas pressure switch. It features a central diaphragm plate (Membrane/Membranteller) that moves up and down based on pressure. This movement operates a micro switch (Mikroschalter) which is connected to three terminals: NO (Normally Open), NC (Normally Closed), and COM (Common). The switch is connected to a setpoint adjustment (Sollwerteneinstellung) mechanism. There are two main pressure connections: one for positive pressure (gas/air) and one for negative pressure (air). A measurement point for positive pressure is also indicated.

**Sollwerteneinstellung**  
Setpoint adjustment

**Mikroschalter**  
Micro switch

**Membrane/  
Membranteller**  
Diaphragm/  
Diaphragm plate

**NO** **NC** **COM**

**Anschluss für Unterdruck (Luft)**  
Connection for negative pressure (air)

**Anschluss für Überdruck (Gas/Luft)**  
Connection for positive pressure (gas/air)

**Messpunkt für Überdruck**  
Measurement point for positive pressure

▶

Ⓚ 🇬🇧 🇩🇪 ⏪ ⏩ ⏸ ⏹ ⏴ ⏵

The interactive animation shows the function of the gas pressure switch DG.

**Click on the picture.** The animation can be controlled using the control bar at the bottom of the window (as on a DVD player).

To play the animation, you will need Adobe Reader 7 or a newer version. If you do not have Adobe Reader on your system, you can download it from the Internet.

Go to [www.adobe.com](http://www.adobe.com), click on "Adobe Reader" in the "Download" section and follow the instructions.

If the animation does not start to play, you can download it from the document library (Docuthek) as an independent application.

## 4 Selection

### 4.1 Selection table

DG..B for positive pressure

DG..U, DG..H, DG..N for positive pressure, negative pressure and differential pressure

DG..H locks off with rising pressure, DG..N locks off with falling pressure

DG..T with NPT connection

DG..S for oxygen and ammonia (without approval)

Type	6	10	30	50	150	400	500	T	G	-3	-4	-5	-6	-9	K2	T	T2	N	A
DG..B, DG..U	●	●	●	●	●	●	●		●	●	●	●	●	●	○	○	○	○	○
DG..H, DG..N		●	●	●	●	●	●		●	●	●	●	●	●	○	○	○	○	○
DG..T	●	●		●	●		●	●	●						● <sup>2)</sup>			● <sup>1)</sup>	
DG..S	●	●		●	●		●		●	●	●	●	●	●	○	○	○	○	○

DG..I for negative pressure

Type	1,5	12	18	120	450	T	G	-3	-4	-5	-6	-9	K2	T	T2	N	A
DG..I	●	●	●	●	●		●	●	●	●	●	●	○	○	○	○	○


<sup>1)</sup> On DG..T, the blue pilot lamp for 120 V AC is fitted as standard.

<sup>2)</sup> On DG..TG, the red/green pilot LED for 24 V DC/AC is fitted as standard.

● = standard, ○ = available

### Order example

DG 10UG-3K2

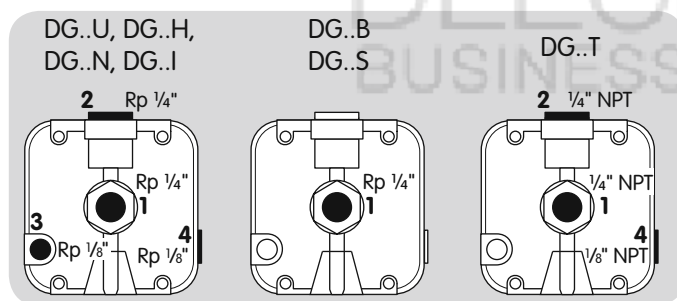

DG..U, DG..H, DG..N, DG..I:  
ports **1** and **2**: Rp 1/4" (standard),  
ports **3** and **4**: Rp 1/8" (standard).

DG..B, DG..S:  
port **1**: Rp 1/4" (standard).

DG..T:  
port **1**: 1/4" NPT (standard) or  
ports **1** and **2**: 1/4" NPT (available),  
port **4**: 1/4" NPT (standard).

## 4.2 Type code

Code	Description
DG	Pressure switch for gas
1,5 – 500	Maximum setting in mbar
B	Positive pressure
U	Positive pressure, negative pressure, differential pressure
H	Locks off with rising pressure
N	Locks off with falling pressure
I	Negative pressure for gas
S	Positive pressure only, for oxygen and ammonia
T	T-product
G	With gold-plated contacts
	Electrical connection:
-3	via screw terminals
-4	via screw terminals, IP 65
-5	via 4-pin plug, without socket
-6	via 4-pin plug, with socket
-9	via 4-pin plug, with socket, IP 65
K2	Red/green pilot LED for 24 V DC/AC
T	Blue pilot lamp for 230 V AC
T2	Red/green pilot LED for 230 V AC
N	Blue pilot lamp for 120 V AC
A	External adjustment

Adjusting range, see page 23 (Adjusting range, switching hysteresis)


DEECHOICE  
BUSINESS PARTNER

## 5 Project planning information

### 5.1 Installation

Installation in the vertical or horizontal position, or sometimes upside down, preferably with vertical diaphragm.

If installed in a vertical position, the switching point  $p_S$  will correspond to the scale value SK set on the hand wheel. If installed in another position, the switching point  $p_S$  will change and no longer correspond to the scale value SK set on the hand wheel. Switching point  $p_S$  must be checked.



DG..U, DG..B, DG..H, DG..N, DG..T, DG..S

$p_S = SK$	$p_S = SK + 0.18 \text{ mbar}$	$p_S = SK - 0.18 \text{ mbar}$
------------	--------------------------------	--------------------------------

DG 1,5I

$p_S = SK$	$p_S = SK + 0.4 \text{ mbar}$ e.g. SK = 1.2: $p_S = 1.2 + 0,4 = 1.6 \text{ mbar}$ e.g. SK = -1.2: $p_S = -1.2 + 0,4 = -0.8 \text{ mbar}$	
------------	------------------------------------------------------------------------------------------------------------------------------------------------------	--

DG 12I

$p_S = SK$	$p_S = SK + 0.5 \text{ mbar}$ e.g. SK = 5: $p_S = 5 + 0,5 = 5.5 \text{ mbar}$ e.g. SK = -10: $p_S = -10 + 0.5 = -9.5 \text{ mbar}$	
------------	------------------------------------------------------------------------------------------------------------------------------------------------	--


DG 18I, DG 120I, DG 450I

$p_S = SK$	DG 18I: $p_S = SK + 0.5 \text{ mbar}$ e.g. SK = -10: $p_S = -10 + 0,5 = -9.5 \text{ mbar}$ DG 120I, DG 450I: $p_S = SK + 0.2 \text{ mbar}$	
------------	-----------------------------------------------------------------------------------------------------------------------------------------------------	--

The housing must not be in contact with masonry. Minimum clearance 20 mm.

The DG..S is suitable for oxygen and ammonia only (diaphragm made of IIR). Do not use for fuel gases – diaphragm not resistant! In the case of oxygen, ensure grease-free installation.

Continuous operation at high temperatures (e.g. maximum ambient temperature) accelerates the ageing of elastomer materials and reduces the service life (please contact manufacturer). Ozone concentrations exceeding  $200 \mu\text{g}/\text{m}^3$  or gases containing more than 0.1 %-by-vol.  $\text{H}_2\text{S}$  accelerate the ageing of elastomer materials and reduce the service life.

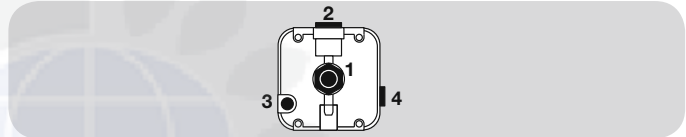

Ports 3 and 4 are connected to the micro switch chamber. The port that is best protected against soiling (dust/humidity) is to be left open for ventilation (positive pressure measurement) to the atmosphere. If dust exposure in the environment is high, a filter pad, see page 20 (Restrictor orifice), or a filter are to be used in the open port.

Combustion gas or a mixture of combustion gas and air must not be connected to port 3 or 4.

Condensation must not be allowed to get into the housing (if possible, install pipework with an ascending gradient). Otherwise, there is a risk of icing of condensation at subzero temperatures, the switching point shifting or corrosion in the device which can lead to malfunctions.




When installing outdoors, place the DL in a roofed area and protect from direct sunlight (even IP 65 version). To avoid condensation, the cover with pressure equalization element can be used, see page 19 (Pressure equalization element).

In case of highly fluctuating pressures, install a restrictor orifice, see page 20 (Restrictor orifice).



## 6 Accessories

### 6.1 Fastening set with screws, U-shape bracket

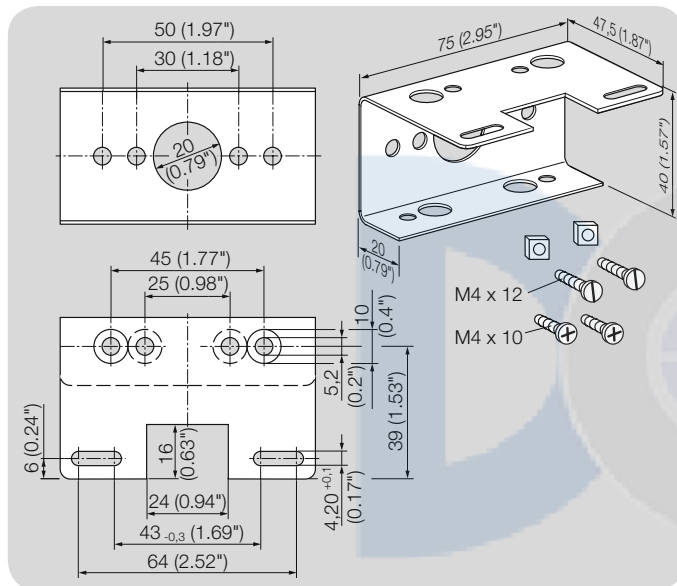

For DG..B, DG..U, DG..I: Order No.: 74915387


### 6.2 Connecting set

DG..U, DG..H, DG..N, DG..I



For monitoring a minimum and maximum inlet pressure  $p_u$  with two pressure switches attached to one another.

Order No.: 74912250

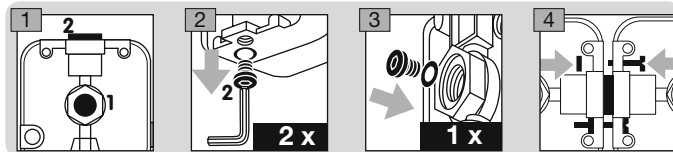


### 6.3 External adjustment




In order to set the switching pressure from the outside, the cover for external adjustment (6 mm Allen key) for DG..B, DG..U and DG..I can be retrofitted.

Order No.: 74916155

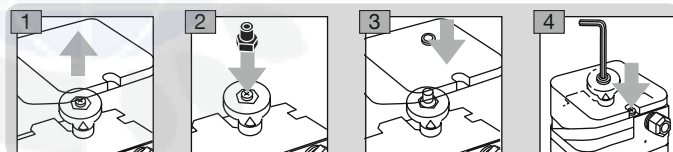


### 6.4 Pressure equalization element



To avoid the formation of condensation, the cover with pressure equalization element can be used. The diaphragm in the screw connector is designed to ventilate the cover, without allowing water to enter.

Order No.: 74923391

## 6.5 Restrictor orifice




In the case of high pressure fluctuations, we recommend using a restrictor orifice (contains non-ferrous metals):

Hole diameter 2 mm, Order No.: 75456321


hole diameter 3 mm, Order No.: 75441317

## 6.6 Test key PIA



To test the min. pressure switch, the DG can be vented in its switched state using the PIA test key (contains non-ferrous metals).

Order No.: 74329466

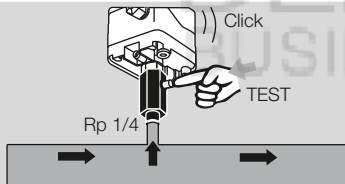


## 6.7 Filter pad set

To protect the electrical contacts in the DG from dirt particles in the surrounding air or in the medium, use a filter pad at the 1/8" negative pressure port. As standard on IP 65 units.

5-piece filter pad set, Order No.: 74916199


## 6.8 Tube set



To be used with air only.


Order No.: 74912952

## 6.9 Standard socket set




Order No.: 74915388

## 6.10 Standard coupler plug



Order No.: 74920412

### 6.11 Pilot lamp set, red or blue

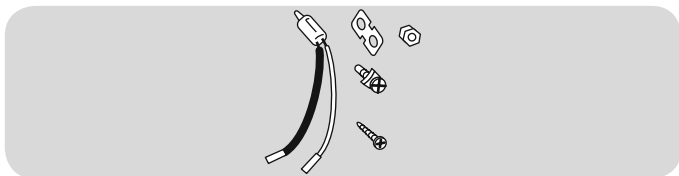

Pilot lamp, red:


110/120 V AC, I = 1.2 mA, Order No.: 74920430

220/250 V AC, I = 0.6 mA, Order No.: 74920429


Pilot lamp, blue:

110/120 V AC, I = 1.2 mA, Order No.: 74916121

220/250 V AC, I = 0.6 mA, Order No.: 74916122

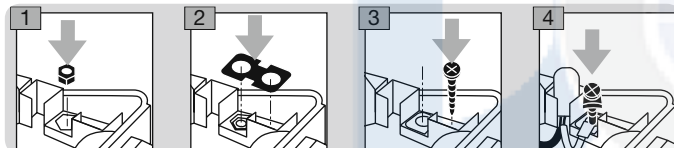


### 6.12 LED set, red/green

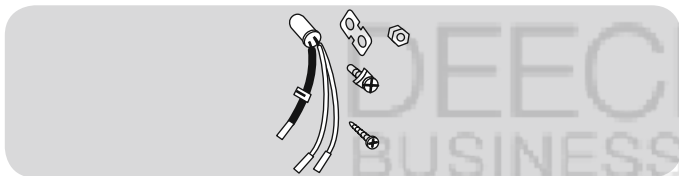

24 V DC, I = 16 mA; 24 V AC, I = 8 mA, Order No.: 74921089

230 V AC, I = 0.6 mA, Order No.: 74923275

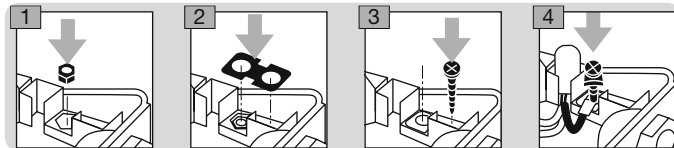

## 7 Technical data

Gas type: natural gas, town gas, LPG (gaseous), flue gas, biologically produced methane (max. 0.1 %-by-vol. H<sub>2</sub>S) and air.

DG: max. inlet pressure  $p_{U \max.} \pm 600$  mbar (8.5 psig).  
Max. test pressure for testing the entire system: temporarily < 15 minutes 2 bar (29 psig).

Switching capacity:

DG:

U = 24–250 V AC,  
I = 0.05–5 A at  $\cos \varphi = 1$ ,  
I = 0.05–1 A at  $\cos \varphi = 0.6$ .

DG..G:

U = 5–250 V AC,  
I = 0.01–5 A at  $\cos \varphi = 1$ ,  
I = 0.01–1 A at  $\cos \varphi = 0.6$ .

DG..G

U = 5–48 V DC,  
I = 0.01–1 A.

DG..T:

U = 30–240 V AC,  
I = 5 A at  $\cos \varphi = 1$ ,  
I = 0.5 A at  $\cos \varphi = 0.6$ .

DG..TG:

U = < 30 V AC,  
I = 0.1 A at  $\cos \varphi = 1$ ,  
I = 0.05 A at  $\cos \varphi = 0.6$ .

If the DG (DG..TG) has switched a voltage > 24 V (> 30 V) and a current > 0.1 A at  $\cos \varphi = 1$  or > 0.05 A at  $\cos \varphi = 0.6$  once, the gold plating on the contacts will have been burnt through. It can then only be operated at this power rating or higher power rating.

Maximum medium and ambient temperatures:  
DG..B, DG..U, DG..I, DG..S: -15 to +80°C (5 to 176°F),  
DG..H, DG..N: -15 to +60°C (5 to 140°F),  
DG..T: -40 to +60 °C (-40 to 140 °F).

Storage and transport temperature:

DG: -40 to +80°C (-40 to 176°F),  
DG..T: -40 to +60 °C (-40 to 140 °F).

RoHS compliant pursuant to 2002/95/EC.

Diaphragm pressure switch, silicone-free.

Diaphragm:

NBR for DG..U, B, N, H, I,  
IIR for DG..S.

Housing: glass fibre reinforced PBT plastic with low gas release.

Lower housing section: AlSi 12.

Enclosure: IP 54 or IP 65.

Safety class: 1.

Line entrance: M16 x 1.5, clamping range: diameters of 4 to 10 mm, DG..T with 1/2" NPT conduit cable gland.

Type of connection: screw terminals.

Weight: 270 to 320 g (9.5 to 11.3 oz), depending on equipment..



## 7.1 Adjusting range, switching hysteresis

On DG..B, DG..U, DG..H, DG..I and DG..T, the scale value is set to the switch-on point, and on DG..N, it is set to the switch-off point.

Type	Adjusting range*		Mean switching differential at min. and max. setting		Difference between switching pressure and possible reset		Deviation from the switching point during testing pursuant to EN 1854	
	mbar	"WC	mbar	"WC	mbar	"WC	Gas pressure switch	Air pressure switch
DG 6T	0.5–6	0.2–2.34	0.2–0.3	0.08–0.12	–	–	± 15%	± 15% or 0.1 mbar (0.04 "WC)
DG 6	0.4–6	–	0.2–0.3	–	–	–	± 15%	± 15% or 0.1 mbar (0.04 "WC)
DG 10	1–10	0.39–3.9	0.25–0.4	0.1–0.16	–	–	± 15%	± 15%
DG 30	2.5–30	–	0.35–0.9	–	–	–	± 15%	± 15%
DG 50	2.5–50	1–19.5	0.8–1.5	0.31–0.59	–	–	± 15%	± 15%
DG 150	30–150	11.7–58.5	3–5	1.17–1.95	–	–	± 15%	± 15%
DG 400	50–400	–	5–15	–	–	–	± 15%	± 15%
DG 500	100–500	39–195	8–17	3.12–6.63	–	–	± 15%	± 15%
DG 10H, DG 10N	1–10	0.39–3.9	–	–	0.4–1	0.16–0.39	± 15%	± 15%
DG 50H, DG 50N	2.5–50	1–19.5	–	–	1–2	0.39–0.78	± 15%	± 15%
DG 150H, DG 150N	30–150	11.7–58.5	–	–	2–5	0.78–1.95	± 15%	± 15%
DG 500H, DG 500N	100–500	39–195	–	–	4–17	1.56–6.63	± 15%	± 15%

\* Adjusting tolerance = ± 15% of the scale value.

Type	Adjusting range* [mbar]	Mean switching differential at min. and max. setting [mbar]	Deviation from the switching point during testing pursuant to EN 1854	
			Gas pressure switch	Air pressure switch
DG 1,5I	-1.5 to -0.5 and +0.5 to +3	0.2–0.5	± 15%	± 15% or 0.4 mbar
DG 12I	-12 to -1 and +1 to +7	0.5–1	± 15%	± 15% or 0.5 mbar
DG 18I	-2 to -18	0.5–1.5	± 15%	± 15% or 0.5 mbar
DG 120I	-10 to -120	4–11	± 15%	± 15%
DG 450I	-80 to -450	10–30	± 15%	± 15%

\* Adjusting tolerance = ± 15% of the scale value.

## 7.2 Safety-specific characteristic values for DG

### For SIL

Suitable for Safety Integrity Level	SIL 1, 2, 3
Diagnostic coverage DC	0
Type of subsystem	Type A to EN 61508-2, 7.4.3.1.2
Mode of operation	High demand mode pursuant to EN 61508-4:2001, 3.5.12

### For PL

Suitable for Performance Level	PL a, b, c, d, e
Category	B, 1, 2, 3, 4
Common cause failure CCF	> 65
Application of essential safety requirements	Satisfied
Application of tried-and-tested safety requirements	Satisfied

### For SIL and PL

	$B_{10d}$ value
U = 24 V DC, I = 10 mA; U = 230 V AC, I = 4 mA	6,689,477 operating cycles
U = 24 V DC, I = 70 mA; U = 230 V AC, I = 20 mA	3,887,652 operating cycles
U = 230 V AC, I = 2 A	974,800 operating cycles
Hardware fault tolerance (1 component/switch) HFT	0
Hardware fault tolerance (2 components/switches, redundant operation) HFT	1



Safe failure fraction SFF	> 90%
---------------------------	-------

Fraction of undetected common cause failures $\beta$	$\geq 2\%$
------------------------------------------------------	------------

Max. service life under operating conditions:  
10 years after date of production, plus max. 1/2 year in storage prior to first use, or once the given number of operating cycles has been reached, depending on which is achieved first.

For a glossary of terms, see page 29 (Glossary).

Max. switching capacity: U = 24 V DC, I = 10 mA; U = 230 V AC, I = 4 mA, 6,689,477 operating cycles

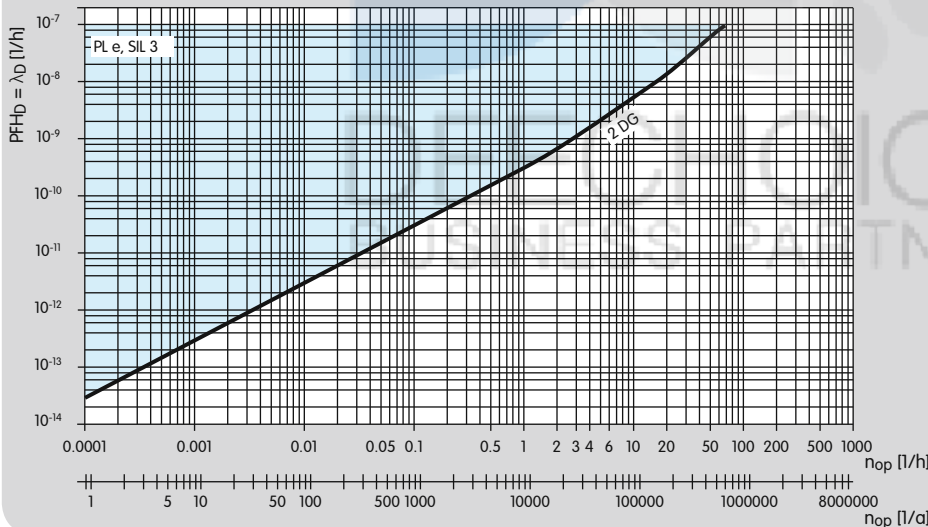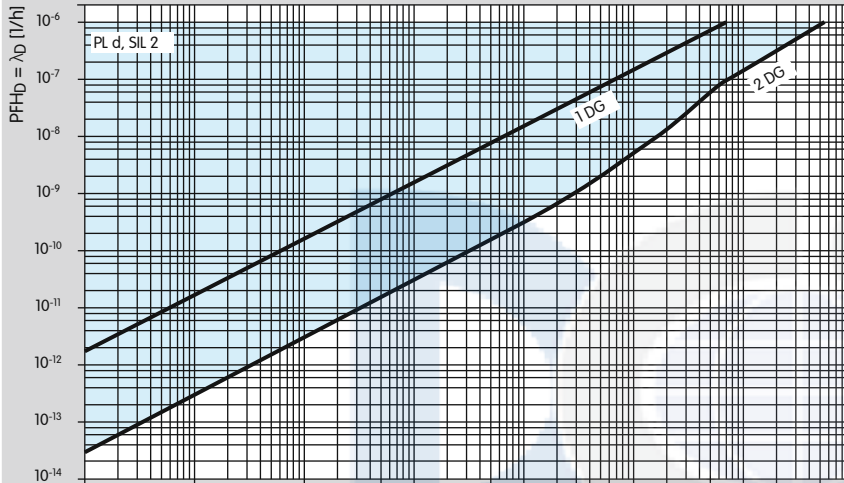

### 7.2.1 Determining the PFH<sub>D</sub> value, the λ<sub>D</sub> value and the MTTF<sub>d</sub> value

$$PFH_D = \lambda_D = \frac{1}{MTTF_d} = \frac{0,1}{B_{10d}} \times n_{op}$$

PFH<sub>D</sub> = Probability of dangerous failure [1/hour]

λ<sub>D</sub> = Mean dangerous failure rate [1/hour]

MTTF<sub>d</sub> = Mean time to dangerous failure [hours]

n<sub>op</sub> = Demand rate (mean number of annual operations) [1/hour]

### 7.2.2 Calculating the PFH<sub>D</sub>

Switch. cap.

n<sub>op</sub> 1/h

n<sub>op</sub> 1/a

Cycle time s

B<sub>10d</sub>

T<sub>10d</sub> a

PFH<sub>D</sub> (1 DG) 1/h



suitable for

PFH<sub>D</sub> (2 DG) 1/h

suitable for



Max. switching capacity:  $U = 24 \text{ V DC}, I = 70 \text{ mA}; U = 230 \text{ V AC}, I = 20 \text{ mA}, 3,887,652 \text{ operating cycles}$

Determining the  $\text{PFH}_D$  value, see page 25 (Calculating the PFHD).

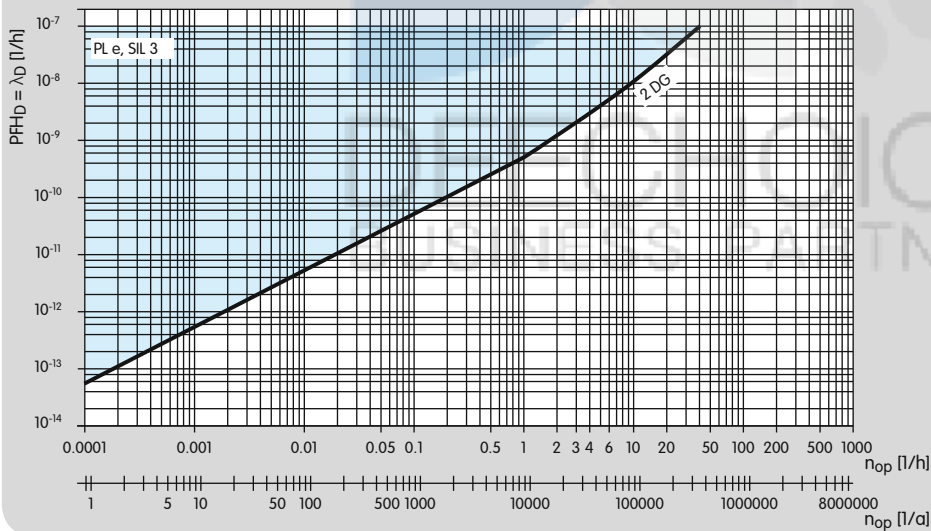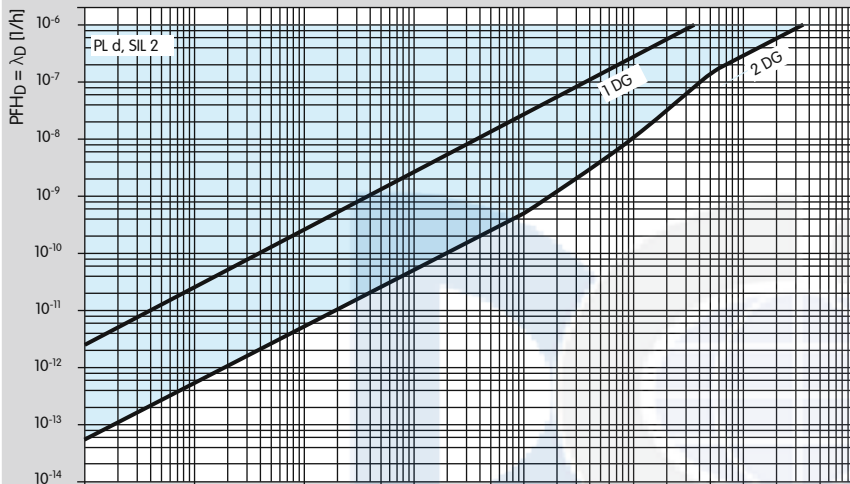


Max. switching capacity:  $U = 230 \text{ V AC}$ ,  $I = 2 \text{ mA}$ , 974,800 operating cycles

Determining the  $\text{PFH}_D$  value, see page 25 (Calculating the PFHD)

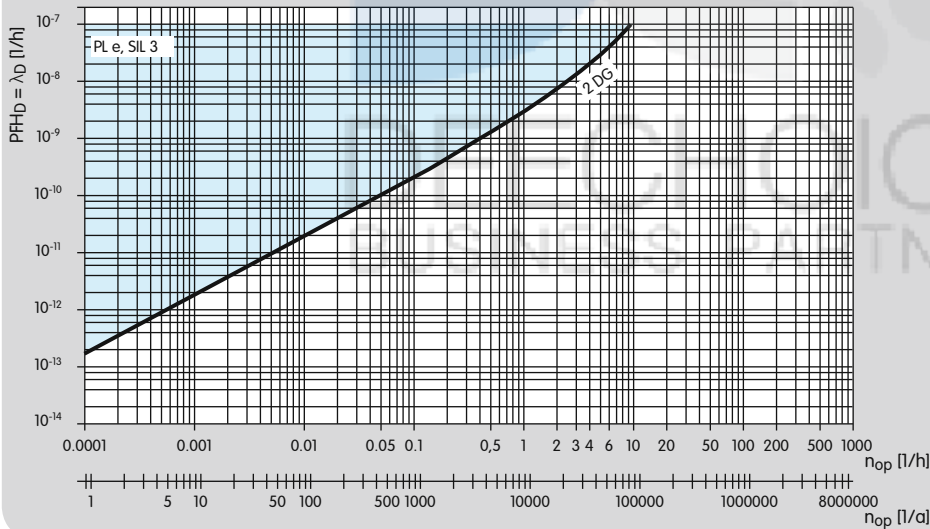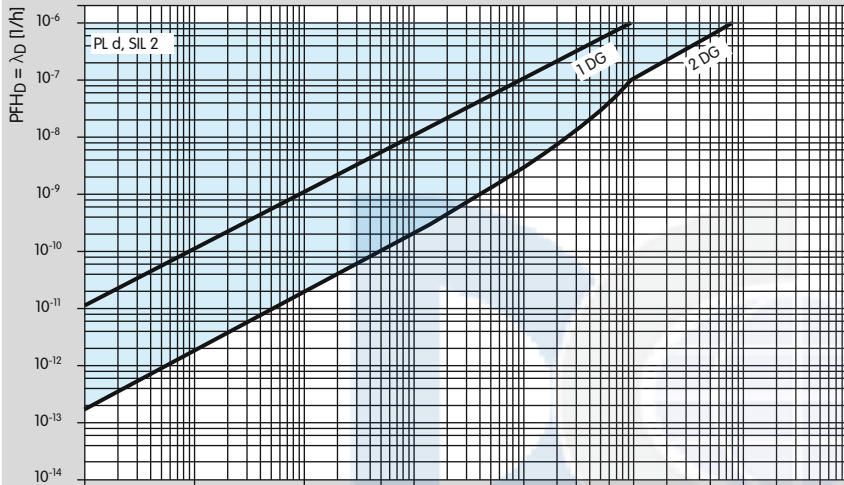

## 7.3 Dimensions

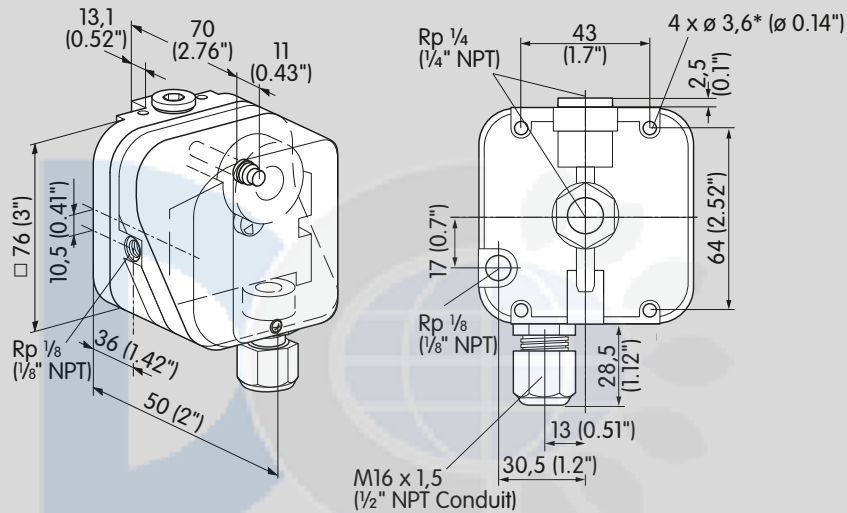

\* Holes 10 mm (0.4") deep, for self-tapping screws.

## 8 Maintenance cycles

At least once a year, twice a year in the case of biologically produced methane.

DEECHOICE  
BUSINESS PARTNER

## 9 Glossary

### 9.1 Diagnostic coverage DC

Measure of the effectiveness of diagnostics, which may be determined as the ratio between the failure rate of detected dangerous failures and the failure rate of total dangerous failures

NOTE: Diagnostic coverage can exist for the whole or parts of a safety-related system. For example, diagnostic coverage could exist for sensors and/or logic system and/or final elements. Unit: %.

from EN ISO 13849-1:2008

### 9.2 Mode of operation

High demand mode or continuous mode

Operating mode, where the frequency of demands for operation made on a safety-related system is greater than one per year or greater than twice the proof-test frequency

from EN 61508-4:2008

### 9.3 Category

Classification of the safety-related parts of a control system in respect of their resistance to faults and their subsequent behaviour in the fault condition, and which is achieved by the structural arrangement of the parts, fault detection and/or by their reliability

from EN ISO 13849-1:2008

### 9.4 Common cause failure CCF

Failures of different items, resulting from a single event, where these failures are not consequences of each other

from EN ISO 13849-1:2008

### 9.5 Fraction of undetected common cause failures $\beta$

Fraction of undetected failures of redundant components due to a single event, whereby these failures are not based on mutual causes

NOTE:  $\beta$  is expressed as a fraction in the equations and as a percentage elsewhere.

from EN 61508-6:2010

### 9.6 $B_{10d}$ value

Mean number of cycles until 10% of the components fail dangerously

from EN ISO 13849-1:2008

### 9.7 $T_{10d}$ value

Mean time until 10% of the components fail dangerously

from EN ISO 13849-1:2008

### 9.8 Hardware fault tolerance HFT

A hardware fault tolerance of N means that N + 1 is the minimum number of faults that could cause a loss of the safety function

from IEC 61508-2:2010

### 9.9 Mean dangerous failure rate $\lambda_D$

Mean rate of dangerous failures during operation time ( $T_{10d}$ ). Unit: 1/h.

from EN ISO 13849-1:2008

### 9.10 Safe failure fraction SFF

Fraction of safe failures related to all failures, which are assumed to appear

from EN 13611/A2:2011

### 9.11 Probability of dangerous failure PFH<sub>D</sub>

Value describing the likelihood of dangerous failure per hour of a component for high demand mode or continuous mode.

Unit: 1/h

from EN 13611/A2:2011

### 9.12 Mean time to dangerous failure MTF<sub>D</sub>

Expectation of the mean time to dangerous failure

from EN ISO 13849-1:2008

### 9.13 Demand rate n<sub>op</sub>

Mean number of annual operations

from EN ISO 13849-1:2008



## Feedback

Finally, we are offering you the opportunity to assess this "Technical Information (TI)" and to give us your opinion, so that we can improve our documents further and suit them to your needs.

### Clarity

Found information quickly  
Searched for a long time  
Didn't find information  
What is missing?  
No answer

### Comprehension

Coherent  
Too complicated  
No answer

### Scope

Too little  
Sufficient  
Too wide  
No answer



### Use

To get to know the product  
To choose a product  
Planning  
To look for information

### Navigation


I can find my way around  
I got "lost"  
No answer

### My scope of functions

Technical department  
Sales  
No answer

### Remarks

(Adobe Reader 7 or higher required)  
[www.adobe.com](http://www.adobe.com)

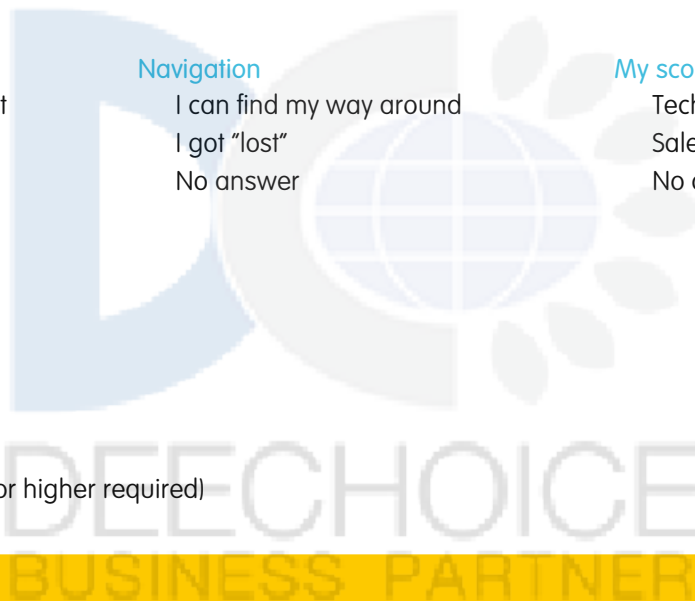

elster  
Kromschroeder

## Contact

Elster GmbH  
Postfach 2809 · 49018 Osnabrück  
Strothweg 1 · 49504 Lotte (Büren)  
Germany

T +49 541 1214-0  
F +49 541 1214-370  
info@kromschroeder.com  
www.kromschroeder.com

The current addresses of our international agents are available on the Internet:  
[www.kromschroeder.de/index.php?id=718&L=1](http://www.kromschroeder.de/index.php?id=718&L=1)

We reserve the right to make technical modifications in the interests of progress.  
Copyright © 2013 Elster GmbH  
All rights reserved.